

Raised Access Floor Barrier

for voids beneath raised access floors



Technical Guide

PRODUCT

AIM Raised Access Floor Barrier prevents the passage of flame and smoke through the under floor cavity, for at least the period of fire rating specified. AIM Raised Access Floor Barrier is made from high density Rockwool stone wool slab, faced with Class 0 impervious foil facing on both sides. It is available cut to size or in slabs suitable for cutting on site.

APPLICATIONS

Raised Access Floor Barriers are required for four applications (requirements for fire barriers):

1 - Subdivision of large uninterrupted cavities

To comply with Building Regulations - 30 minutes' integrity plus 15 minutes' insulation. The AIM Raised Access Floor Fire Barrier meets and exceeds the requirements of Approved Document Part B (in England and Wales) as well as the fire safety sections of other UK Building Regulations'.

2 - Alignment under a partition, to maintain partition rating


- i) 30 minute partition - 30 minutes' integrity plus 30 minutes' insulation.
- ii) 60 minute partition - 60 minutes' integrity plus 60 minutes' insulation.
- iii) 120 minute partition - 120 minutes' integrity plus 120 minutes' insulation.

3 - Reduce flanking transmission of sound

The AIM Raised Access Floor Barrier can be used to reduce flanking transmission of sound through the void it fills by at least 21 dB R_w

4 - Plenum Applications

The AIM Raised Access Floor Barrier can also be used to help create a Plenum chamber under a raised access floor system.

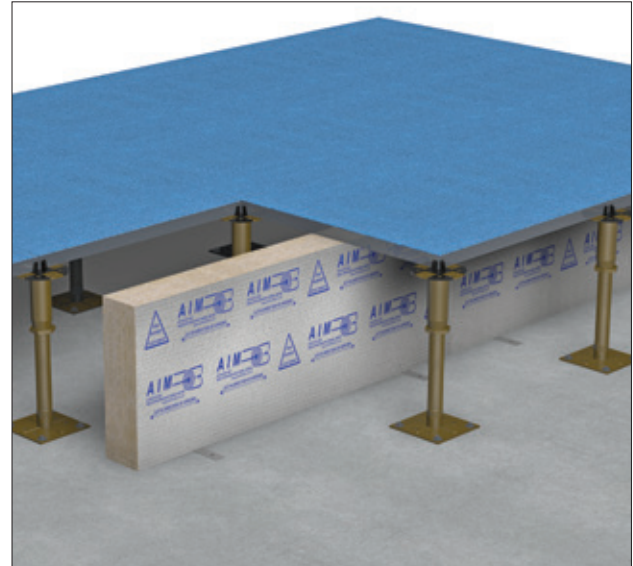

Example product installation schematic using materials by others

FEATURES

- High density foil faced stone wool barrier.
- Thicknesses to provide ½, 1 and 2 hour fire rating.
- For use within voids up to 400mm.
- Reduces airborne transmission of sound by a minimum of 21 dB R_w
- Solutions for power & communication cables.

BENEFITS

- Prevents the passage of fire and smoke through underfloor cavities.
- Reduces airborne sound through underfloor voids.
- The product provides up to 120 minutes Integrity & Insulation when tested to BS EN and the principles of TR31.
- Allows for power and communications to be run below the barrier.



PHYSICAL INFORMATION

- Length: 1000mm
- Widths: 75mm, 100mm & 125mm
(depending on the fire rating required)
- Voids: 50 - 400mm
(barrier to be compressed by 5%)
- Available cut to size and supplied with the required fixing clips
- Available in slab form for cutting on site as required
- Foil faced (see options)
- Also available Polythene sleeved
- Thermal Conductivity $\lambda = 0.036\text{W/mK}$


PACKAGING

AIM Raised Access Floor Fire Barrier are generally packed into cartons and stretch wrapped onto wooden pallets with a showerproof polythene pallet cover and high quality edge protectors. We are also able to provide product without cartons if required.

Orders for slab and half slab barrier will be supplied stretch wrapped onto pallets with a showerproof polythene pallet cover and edge protection (ie, no cartons).

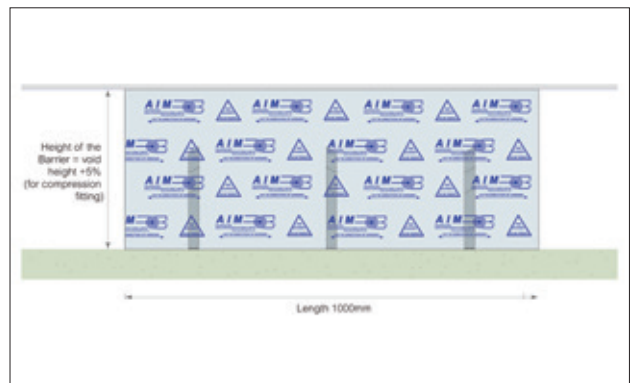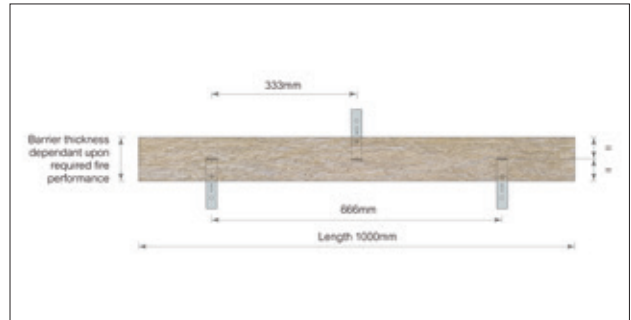


COMPONENTS available from AIM

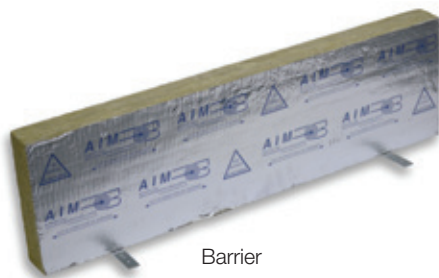


Barrier



Acrylic fire rated intumescent mastic (optional extra)

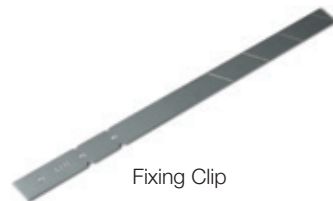

Fixing Clip



Foil tape for sealing joints (optional extra)
Length - 45m Widths - 100mm, 125mm and 150mm

AS STANDARD

AIM Raised Access Floor Barrier is supplied pre-cut in 1000mm lengths and three standard thicknesses depending on the fire rating required. The product supplied is as required to fill the void.

The pre-cut product is supplied with the required fixing clips.

OPTIONS

The AIM Raised Access Floor Barrier is also available in slab form for cutting on site as required. When ordering in slab form the clips should be purchased separately.

The product is also available fully foil enclosed for use within plenum applications. It can also be supplied polythene sleeved.

Foil tapes of 45m length and in widths of 100, 125 and 150mm for the optional sealing of joints.

TECHNICAL INFORMATION

Fire Performance

Tested to BS EN 1366-4

The access floor and structural slab should have a proven fire rating at least equal to that of the barrier.

Fire Rating	Integrity	Insulation fire resistance	Barrier thickness	Maximum void
1/2 hour	120 minutes	30 minutes	75mm	400mm
1 hour	120 minutes	60 minutes	100mm	400mm
2 hour	120 minutes	120 minutes	125mm	400mm

Acoustic Performance

AIM Raised Access Floor Barrier provides at least 21dB R_w sound reduction.

When tested in-conjunction with a carpeted Kingspan Raised Access Floor system, the room to room sound reduction was at least 52 dB_{nw} through the path of the fire barrier. This result was achieved with all fire solutions.

Plenum Chambers

The ultimate performance of the installations airtightness is highly dependent upon the manner of installation. It cannot be guaranteed prior to site installation and accordingly should be tested at site.

TEST REPORTS

WF 432725 = 1/2 hour and 1 hour barriers

WF 432729 = 2 hour barrier and cables passing under the barrier

Tests are conducted to BS EN 1366-4 and the principles of TR31.

Z11012 – Acoustic Performance – Testing on mineral fibre insulation. To BS EN ISO 10140-2.

SRL Test report 24868-SRL-RP-XT-001-P1



AIM are partners with NBS. Our products can be found on NBS Source and have been authored to NBS specification standards and have both CAWS and Uniclass 2015 classifications.

INSTALLATION GUIDELINES

Items required for installation



PPE abrasion resistant gloves



PPE impact resistant goggles



RPE dust mask - FFP3



Drill



Insulation saw




Screwdriver



Tape measure

- 1 Measure the void depth and add 5%. Mark the slab and carefully cut using an insulation saw or hand saw. Please cut in the direction of the arrows printed on the foil facing.


Please note: This step is not required if the barrier supplied has been pre-cut to the identified void size.

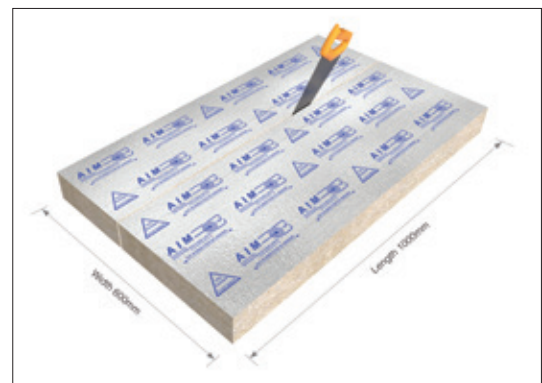


- 2 The product is installed with three 'L' clips per length of barrier

Snap the fixing clips to the correct length.

Dimension 'X' should be three quarters of the barriers height.

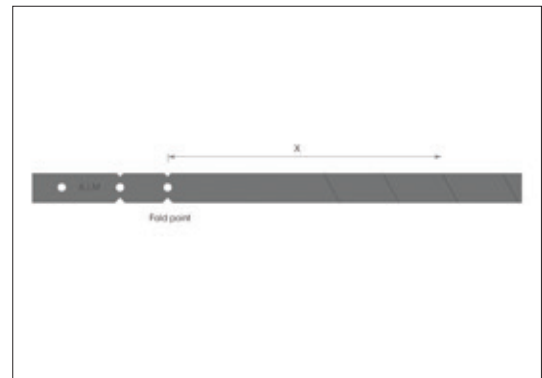


- 3 For all voids three 'L' angle brackets are supplied per length. Form the three fixing clips to 90° to form an 'L' shape.

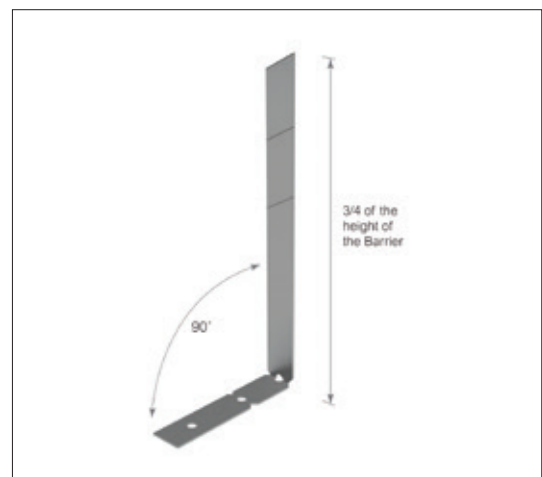


- 4** Insert into the base of the barrier to approximately $\frac{3}{4}$ depth with the two end brackets having their 'leg' to one side of the barrier and the middle one with its leg to the other side.

The clips should be at 333mm nominal centres.

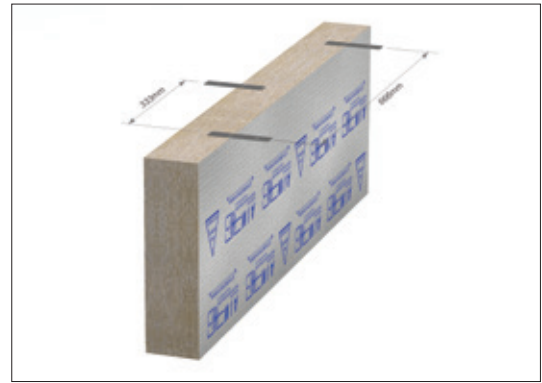

- 5** Place the barrier into position ensuring a tight butt joint between sections.

Secure the three fixings to the substrate using non-combustible fixings.

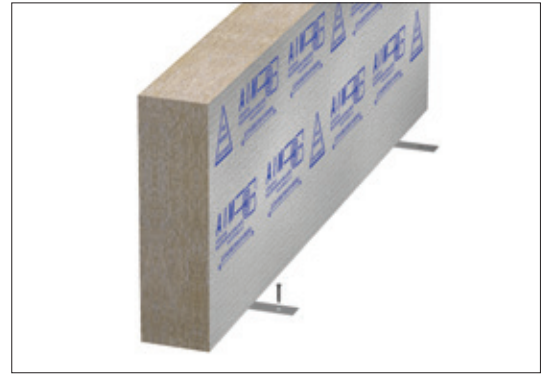


- 6** The Barrier should maintain contact with the underside of the access floor and the top of the structural floor so that no gaps are present, as this may risk loss of integrity. The barrier should be installed so that it completely fills the cavity without any gaps or voids.

Fit the access floor tile ensuring that the barrier is held under compression. Minor imperfections or any gaps caused by joints or coffers in the floor should be sealed with a fire rated intumescent mastic.




- 7** If cables pass the cavity barrier line then these should be secured 150mm away from each edge of the barrier.

The system allows for up to five CAT5e or five 2.5mm three core PVC cable to be secured to the substrate and run below the Raised Access Floor Fire Barrier. Please contact AIM for specific installation guidance.

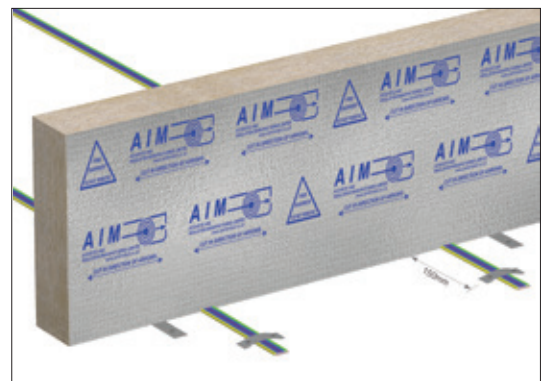


- 8** Prior to installing the Raised Access Floor Barrier, ensure there is intumescent mastic all around the cables. Once the slab is fitted, check for gaps and add more mastic if required.

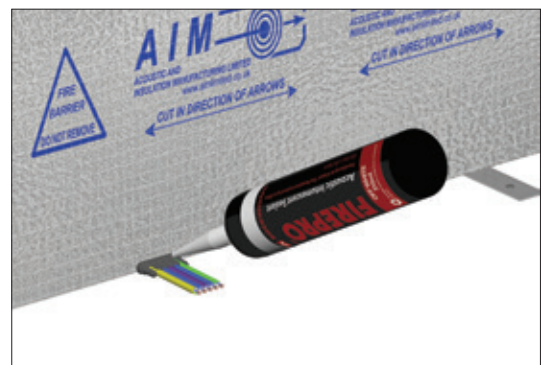

PLENUM APPLICATIONS

For Plenum applications we can supply the AIM Raised Access Floor Barrier fully foil enclosed. The barrier should then be installed on a bed of mastic with all vertical joints sealed with foil tape to ensure airtightness.

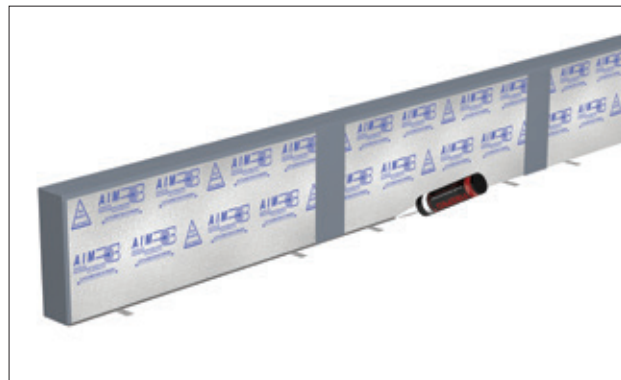

STORAGE

Products are supplied on wooden pallets with edge protection and a shower proof hood. Products should be stored away from the elements until ready for installation.

MAINTENANCE

This product does not contain moving parts and, if undisturbed in the underfloor cavity, requires no routine inspections or maintenance.

It is recommended that the integrity of the barrier is rechecked if further works are carried out that may involve disturbing the product e.g. installing new cables.

HEALTH & SAFETY

Insulation products supplied by AIM are considered to be inert articles and as such are exempt from requirements to provide a Safety Data Sheet.

A Product Safety and Handling Information Sheet is available upon request.

ENVIRONMENT

Global warming potential = zero

For product recycling please contact: Rockwool
T: 01656 868400 E: recycling@rockwool.co.uk

ORDERING

To order this product the following information will be required:

- Underfloor void Height
- Fire Performance Required
- Approximate Quantity
- Delivery location

Products are typically supplied in seven to ten working days but lead times may vary depending on existing factory commitments.

There is no minimum order quantity or value although small orders may attract transport surcharges.

TECHNICAL SUPPORT

Technical Support is available from our experienced sales team on 01293 582 400 or sales@aimlimited.co.uk

ABOUT AIM

AIM are a quality insulation convertor with over 30 years experience in the design, testing & manufacturing of high quality fire barriers for customers worldwide.

AIM are members of



AIM working in partnership with



Raised Access Floor System
acoustic test conducted with



T 01293 582400
E sales@aimlimited.co.uk
W www.aimlimited.co.uk